


室内灯具光度数据


| | | |
|--|-------|-------|
| 实测参数: U:119.75V I:0.1033A P:9.2100W PF:0.7442 Freq:59.98Hz UTHDi:0.00% ITHDi:0.00% KDisp:0 实检光通: 633.468x1 lm | | |
| 灯具名称: LED-S9W-5CCT-WH-SQ-BF | 灯具类型: | 灯具重量: |
| 灯具规格: 2700K | 外型尺寸: | 测试编号: |
| 制造厂商: | 发光口面: | 遮光角: |

| 光源数据 | | 光度数据 | | | | 光效: 68.78 lm/W |
|------------|-----------------------|-----------|--------|--------------------------|--|----------------|
| 型号 | LED-S9W-5CCT-WH-SQ-BF | 峰值光强 (cd) | 234.0 | S/MH (C0/180) | | 1.26 |
| 标称功率 (W) | 9 | 灯具效率 (%) | 100.0 | S/MH (C90/270) | | 1.25 |
| 额定电源电压 (V) | 120 | 总光通量 (lm) | 633.47 | η UP, DN (C0-180) | | 0.0, 50.4 |
| 额定光通量 (lm) | 633.468 | CIE分类 | 直接 | η UP, DN (C180-360) | | 0.0, 49.6 |
| 灯具内光源数 (只) | 1 | 上射光通比 (%) | 0.0 | CIBSE SHR NOM | | 1.25 |
| 实测电源电压 (V) | 120 | 下射光通比 (%) | 100.0 | CIBSE SHR MAX | | 1.35 |

室内灯具配光曲线

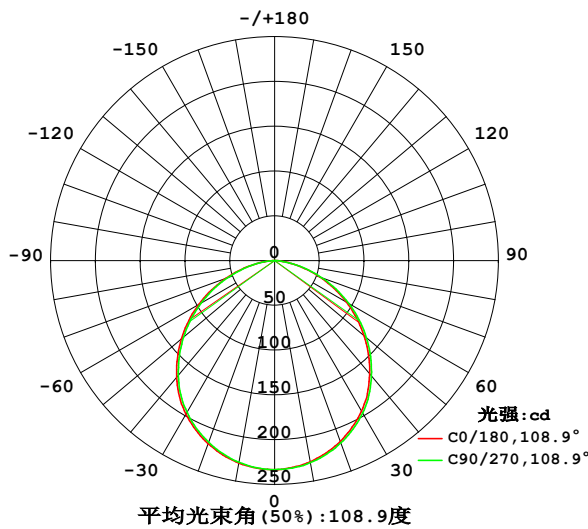

空间等照度曲线 (单位: lx)

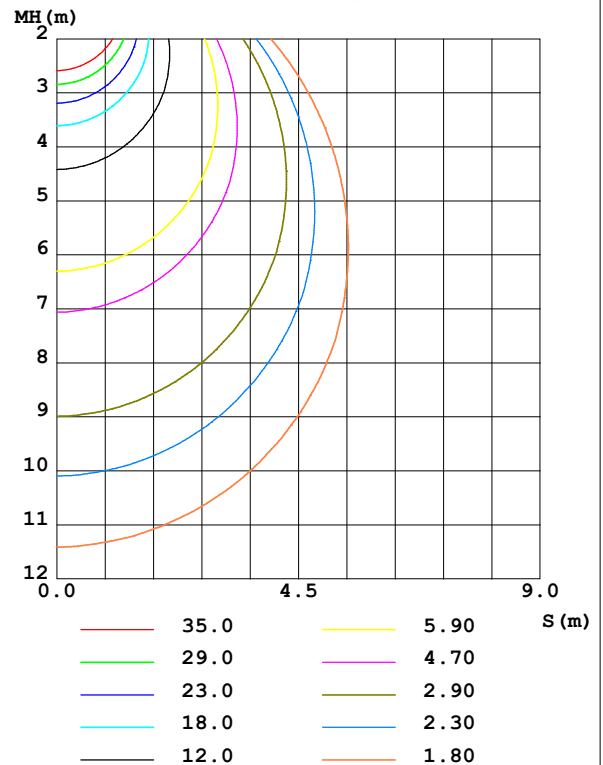

C角度范围: 0度 - 360度
C角度间隔: 22.5度
测试速度: 快速
环境温度: 25.3°C
测试人员:
测试日期: 2023-02-02

γ 角度范围: 0度 - 90度
 γ 角度间隔: 1.0度
测试系统: 远方 (EVERFINE) GO-SPEX500_V1 系统 V2.00.460
环境湿度: 65.0%
测试距离: 3.090米 [K=1.0000]
备注:

灯具环带光通量

环带光通量:


| γ | C0 | C45 | C90 | C135 | C180 | C225 | C270 | C315 | $\gamma(^{\circ})$ | $\Phi_{\text{环}}$ | $\Phi_{\text{总}}$ | %lum,lamp |
|----------|--------|--------|--------|--------|--------|--------|--------|--------|--------------------|-------------------|-------------------|-----------|
| 10 | 228.1 | 229.7 | 229.1 | 229.2 | 229.6 | 228.3 | 228.7 | 228.4 | 0- 10 | 22.06 | 22.06 | 3.48,3.48 |
| 20 | 214.8 | 217.8 | 216.5 | 216.7 | 217.7 | 214.9 | 215.9 | 215.5 | 10- 20 | 63.09 | 85.15 | 13.4,13.4 |
| 30 | 194.3 | 197.9 | 196.5 | 196.9 | 198.1 | 194.2 | 195.7 | 194.7 | 20- 30 | 95.39 | 180.5 | 28.5,28.5 |
| 40 | 165.2 | 171.7 | 168.2 | 170.2 | 170.2 | 167.3 | 167.3 | 167.6 | 30- 40 | 114.6 | 295.2 | 46.6,46.6 |
| 50 | 130.4 | 137.2 | 133.8 | 136.2 | 135.8 | 132.2 | 132.7 | 132.9 | 40- 50 | 117.1 | 412.3 | 65.1,65.1 |
| 60 | 92.69 | 97.17 | 95.57 | 97.07 | 97.72 | 92.22 | 94.71 | 92.82 | 50- 60 | 102.7 | 514.9 | 81.3,81.3 |
| 70 | 53.61 | 55.62 | 55.84 | 55.96 | 57.87 | 52.03 | 55.64 | 52.64 | 60- 70 | 74.10 | 589.0 | 93,93 |
| 80 | 18.64 | 17.16 | 19.35 | 19.12 | 21.33 | 15.36 | 20.02 | 16.81 | 70- 80 | 37.96 | 627.0 | 99,99 |
| 90 | 0.2394 | 0.2227 | 0.2354 | 0.2266 | 0.1486 | 0.1383 | 0.1676 | 0.1450 | 80- 90 | 6.464 | 633.5 | 100,100 |
| 100 | | | | | | | | | 90-100 | | | |
| 110 | | | | | | | | | 100-110 | | | |
| 120 | | | | | | | | | 110-120 | | | |
| 130 | | | | | | | | | 120-130 | | | |
| 140 | | | | | | | | | 130-140 | | | |
| 150 | | | | | | | | | 140-150 | | | |
| 160 | | | | | | | | | 150-160 | | | |
| 170 | | | | | | | | | 160-170 | | | |
| 180 | | | | | | | | | 170-180 | | | |
| 单位:° | 光强:cd | | | | | | | | | 单位:lm | | |

C角度范围: 0度 - 360度
C角度间隔: 22.5度
测试速度: 快速
环境温度: 25.3℃
测试人员:
测试日期: 2023-02-02

γ 角度范围: 0度 - 90度
 γ 角度间隔: 1.0度
测试系统: 远方(EVERFINE)GO-SPEX500_V1系统 V2.00.460
环境湿度: 65.0%
测试距离: 3.090米 [K=1.0000]
备注:

灯具亮度限制曲线

| | | |
|--|-------|-------|
| 实测参数: U:119.75V I:0.1033A P:9.2100W PF:0.7442 Freq:59.98Hz UTHDi:0.00% ITHDi:0.00% KDisp:0 实检光通: 633.468x1 lm | | |
| 灯具名称: LED-S9W-5CCT-WH-SQ-BF | 灯具类型: | 灯具重量: |
| 灯具规格: 2700K | 外型尺寸: | 测试编号: |
| 制造厂商: | 发光口面: | 遮光角: |

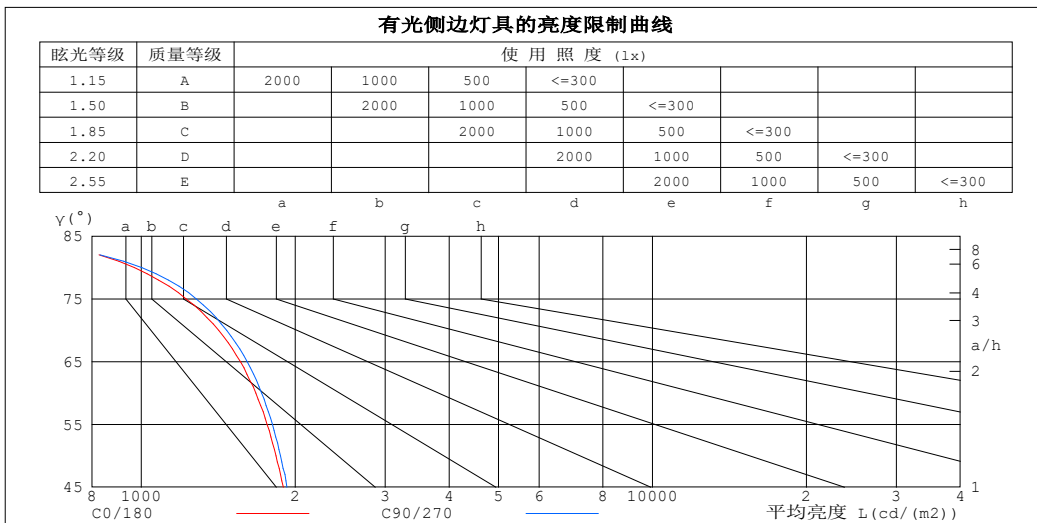

| 平均亮度值 cd/(m2) | | |
|---------------|--------|---------|
| γ (°) | C0/180 | C90/270 |
| 85 | 419 | 346 |
| 80 | 970 | 1002 |
| 75 | 1223 | 1280 |
| 70 | 1417 | 1468 |
| 65 | 1562 | 1610 |
| 60 | 1676 | 1719 |
| 55 | 1762 | 1804 |
| 50 | 1834 | 1872 |
| 45 | 1896 | 1927 |


C角度范围: 0度 - 360度
 C角度间隔: 22.5度
 测试速度: 快速
 环境温度: 25.3℃
 测试人员:
 测试日期: 2023-02-02

γ角度范围: 0度 - 90度
 γ角度间隔: 1.0度
 测试系统: 远方 (EVERFINE) GO-SPEX500_V1 系统 V2.00.460
 环境湿度: 65.0%
 测试距离: 3.090米 [K=1.0000]
 备注:

工作面利用系数和灯具概算曲线

| | | |
|--|-------|-------|
| 实测参数: U:119.75V I:0.1033A P:9.2100W PF:0.7442 Freq:59.98Hz UTHDi:0.00% ITHDi:0.00% KDisp:0 实检光通: 633.468x1 lm | | |
| 灯具名称: LED-S9W-5CCT-WH-SQ-BF | 灯具类型: | 灯具重量: |
| 灯具规格: 2700K | 外型尺寸: | 测试编号: |
| 制造厂商: | 发光口面: | 遮光角: |

| 顶棚 | 80% | | | 70% | | | 50% | | | 30% | | | 10% | | | 0 |
|------|---------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|
| 墙面 | 50% | 30% | 10% | 50% | 30% | 10% | 50% | 30% | 10% | 50% | 30% | 10% | 50% | 30% | 10% | 0 |
| 地板 | 20% | | | 20% | | | 20% | | | 20% | | | 20% | | | 0 |
| 室空间比 | 工作面利用系数 | | | | | | | | | | | | | | | |
| 0.0 | 1.19 | 1.19 | 1.19 | 1.16 | 1.16 | 1.16 | 1.11 | 1.11 | 1.11 | 1.06 | 1.06 | 1.06 | 1.02 | 1.02 | 1.02 | 1.00 |
| 1.0 | 1.05 | 1.01 | .97 | 1.02 | .99 | .95 | .98 | .95 | .92 | .94 | .92 | .90 | .91 | .89 | .87 | .85 |
| 2.0 | .92 | .85 | .79 | .90 | .84 | .78 | .86 | .81 | .77 | .83 | .79 | .75 | .80 | .76 | .73 | .71 |
| 3.0 | .81 | .73 | .66 | .79 | .72 | .66 | .76 | .70 | .64 | .73 | .68 | .63 | .71 | .66 | .62 | .60 |
| 4.0 | .71 | .63 | .56 | .70 | .62 | .56 | .68 | .61 | .55 | .65 | .59 | .54 | .63 | .58 | .54 | .51 |
| 5.0 | .64 | .55 | .49 | .63 | .54 | .48 | .61 | .53 | .48 | .59 | .52 | .47 | .57 | .51 | .47 | .45 |
| 6.0 | .58 | .49 | .42 | .57 | .48 | .42 | .55 | .47 | .42 | .53 | .47 | .41 | .52 | .46 | .41 | .39 |
| 7.0 | .52 | .44 | .37 | .51 | .43 | .37 | .50 | .42 | .37 | .48 | .42 | .37 | .47 | .41 | .36 | .35 |
| 8.0 | .48 | .39 | .33 | .47 | .39 | .33 | .46 | .38 | .33 | .44 | .38 | .33 | .43 | .37 | .33 | .31 |
| 9.0 | .44 | .36 | .30 | .43 | .35 | .30 | .42 | .35 | .30 | .41 | .34 | .30 | .40 | .34 | .30 | .28 |
| 10.0 | .40 | .33 | .27 | .40 | .32 | .27 | .39 | .32 | .27 | .38 | .32 | .27 | .37 | .31 | .27 | .25 |

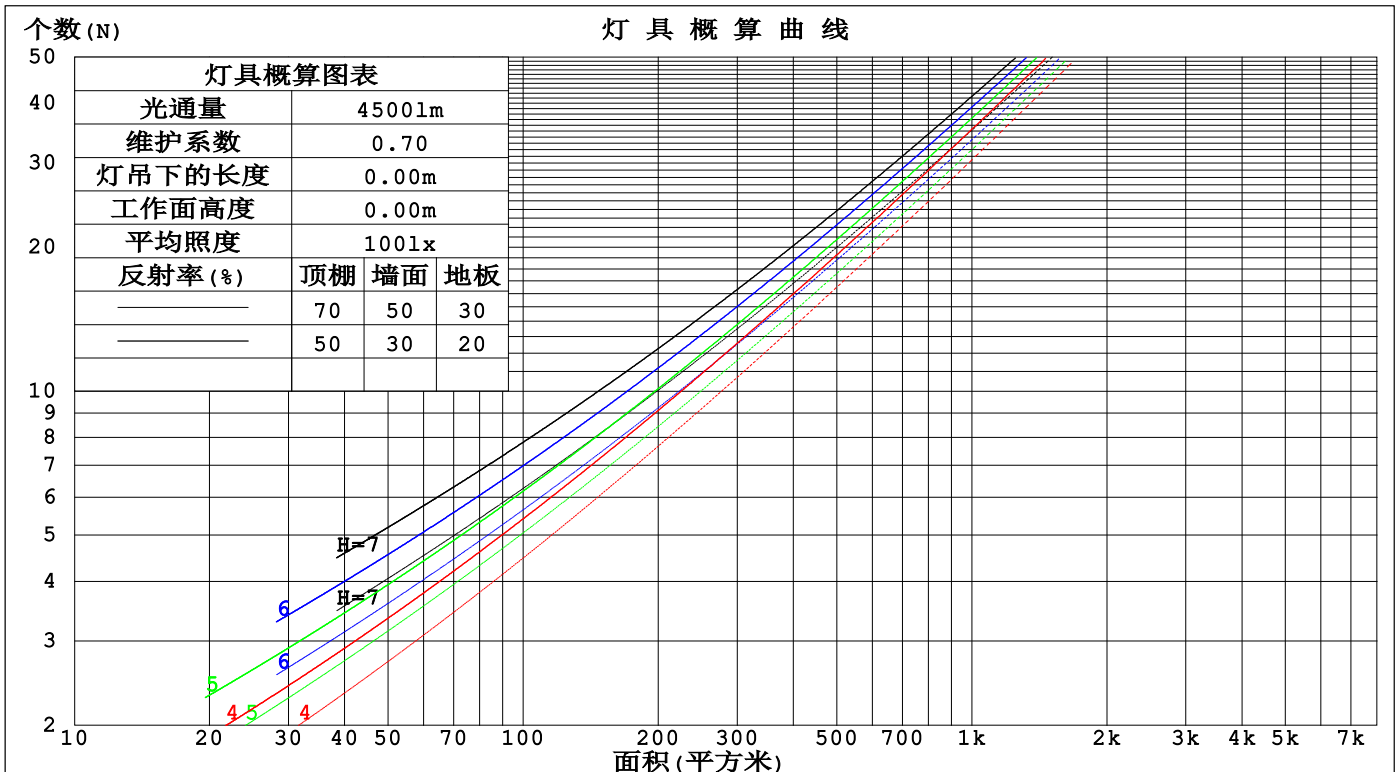

C角度范围: 0度 - 360度
 C角度间隔: 22.5度
 测试速度: 快速
 环境温度: 25.3℃
 测试人员:
 测试日期: 2023-02-02

γ角度范围: 0度 - 90度
 γ角度间隔: 1.0度
 测试系统: 远方(EVERFINE)GO-SPEX500_V1系统 V2.00.460
 环境湿度: 65.0%
 测试距离: 3.090米 [K=1.0000]
 备注:

墙面和天花板利用系数

| | | | | | |
|---|--|-------|--|-------|--|
| 实测参数: U:119.75V I:0.1033A P:9.2100W PF:0.7442 Freq:59.98Hz UTHDi:0.00% ITHDi:0.00% KDisp:0 实检光通: 633.468x1 lm | | | | | |
| 灯具名称: LED-S9W-5CCT-WH-SQ-BF | | 灯具类型: | | 灯具重量: | |
| 灯具规格: 2700K | | 外型尺寸: | | 测试编号: | |
| 制造厂商: | | 发光口面: | | 遮光角: | |

| 顶棚 | 80% | | | 70% | | | 50% | | | 30% | | | 10% | | | 0 |
|------|---------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|---|
| 墙面 | 50% | 30% | 10% | 50% | 30% | 10% | 50% | 30% | 10% | 50% | 30% | 10% | 50% | 30% | 10% | 0 |
| 地板 | 20% | | | 20% | | | 20% | | | 20% | | | 20% | | | 0 |
| 室空间比 | 墙壁面利用系数 | | | | | | | | | | | | | | | |
| 0.0 | | | | | | | | | | | | | | | | |
| 1.0 | .294 | .167 | .053 | .287 | .164 | .052 | .273 | .157 | .050 | .261 | .151 | .048 | .250 | .145 | .047 | |
| 2.0 | .281 | .154 | .047 | .275 | .151 | .047 | .263 | .146 | .045 | .252 | .142 | .044 | .243 | .137 | .043 | |
| 3.0 | .262 | .140 | .042 | .257 | .137 | .041 | .246 | .134 | .041 | .237 | .130 | .040 | .228 | .126 | .039 | |
| 4.0 | .243 | .126 | .037 | .238 | .125 | .037 | .229 | .122 | .036 | .221 | .119 | .036 | .213 | .116 | .035 | |
| 5.0 | .226 | .115 | .033 | .222 | .114 | .033 | .213 | .111 | .033 | .206 | .109 | .032 | .199 | .106 | .032 | |
| 6.0 | .210 | .105 | .030 | .206 | .104 | .030 | .199 | .102 | .030 | .192 | .100 | .029 | .186 | .098 | .029 | |
| 7.0 | .196 | .097 | .027 | .193 | .096 | .027 | .186 | .094 | .027 | .180 | .092 | .027 | .174 | .091 | .027 | |
| 8.0 | .183 | .090 | .025 | .180 | .089 | .025 | .175 | .087 | .025 | .169 | .086 | .025 | .164 | .084 | .025 | |
| 9.0 | .172 | .083 | .023 | .169 | .083 | .023 | .164 | .081 | .023 | .159 | .080 | .023 | .155 | .079 | .023 | |
| 10.0 | .162 | .078 | .022 | .160 | .077 | .021 | .155 | .076 | .021 | .150 | .075 | .021 | .146 | .074 | .021 | |

| 顶棚 | 80% | | | 70% | | | 50% | | | 30% | | | 10% | | | 0 |
|------|---------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|---|
| 墙面 | 50% | 30% | 10% | 50% | 30% | 10% | 50% | 30% | 10% | 50% | 30% | 10% | 50% | 30% | 10% | 0 |
| 地板 | 20% | | | 20% | | | 20% | | | 20% | | | 20% | | | 0 |
| 室空间比 | 天花板利用系数 | | | | | | | | | | | | | | | |
| 0.0 | .190 | .190 | .190 | .163 | .163 | .163 | .111 | .111 | .111 | .064 | .064 | .064 | .020 | .020 | .020 | |
| 1.0 | .179 | .156 | .136 | .153 | .134 | .117 | .105 | .092 | .081 | .060 | .053 | .047 | .019 | .017 | .015 | |
| 2.0 | .171 | .132 | .099 | .146 | .114 | .086 | .100 | .079 | .060 | .058 | .046 | .035 | .019 | .015 | .011 | |
| 3.0 | .163 | .114 | .075 | .140 | .099 | .065 | .096 | .068 | .046 | .055 | .040 | .027 | .018 | .013 | .009 | |
| 4.0 | .155 | .101 | .059 | .133 | .087 | .051 | .092 | .061 | .036 | .053 | .036 | .021 | .017 | .012 | .007 | |
| 5.0 | .148 | .090 | .048 | .127 | .078 | .042 | .088 | .055 | .029 | .051 | .032 | .017 | .016 | .010 | .006 | |
| 6.0 | .141 | .082 | .040 | .121 | .071 | .035 | .084 | .050 | .024 | .049 | .029 | .015 | .016 | .010 | .005 | |
| 7.0 | .134 | .075 | .034 | .116 | .065 | .029 | .080 | .046 | .021 | .046 | .027 | .012 | .015 | .009 | .004 | |
| 8.0 | .128 | .069 | .029 | .110 | .060 | .025 | .076 | .042 | .018 | .044 | .025 | .011 | .014 | .008 | .004 | |
| 9.0 | .122 | .064 | .025 | .105 | .056 | .022 | .073 | .039 | .016 | .042 | .023 | .009 | .014 | .008 | .003 | |
| 10.0 | .116 | .060 | .023 | .100 | .052 | .020 | .070 | .037 | .014 | .041 | .022 | .008 | .013 | .007 | .003 | |

C角度范围: 0度 - 360度
 C角度间隔: 22.5度
 测试速度: 快速
 环境温度: 25.3℃
 测试人员:
 测试日期: 2023-02-02

γ角度范围: 0度 - 90度
 γ角度间隔: 1.0度
 测试系统: 远方(EVERFINE)GO-SPEX500_V1系统 V2.00.460
 环境湿度: 65.0%
 测试距离: 3.090米 [K=1.0000]
 备注:

UGR (Unified Glare Rating) 数据表

| | | | | | | | | | | | | | |
|--|-----|-----------------------|-----|-------|------|------|---------------------|------|------|------|------|------|------|
| 实测参数: U:119.75V I:0.1033A P:9.2100W PF:0.7442 Freq:59.98Hz UTHDi:0.00% ITHDi:0.00% KDisp:0 实检光通: 633.468x1 lm | | | | | | | | | | | | | |
| 灯具名称: LED-S9W-5CCT-WH-SQ-BF | | | | 灯具类型: | | | 灯具重量: | | | | | | |
| 灯具规格: 2700K | | | | 外型尺寸: | | | 测试编号: | | | | | | |
| 制造厂商: | | | | 发光口面: | | | 遮光角: | | | | | | |
| 反射比: | 天花板 | 0.7 | 0.7 | 0.5 | 0.5 | 0.3 | 0.7 | 0.7 | 0.5 | 0.5 | 0.3 | | |
| | 墙面 | 0.5 | 0.3 | 0.5 | 0.3 | 0.3 | 0.5 | 0.3 | 0.5 | 0.3 | 0.3 | | |
| | 工作面 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | | |
| 房间尺寸 | | 横向 (Viewed crosswise) | | | | | 纵向 (Viewed endwise) | | | | | | |
| x = | 2H | y = | 2H | 16.5 | 18.0 | 16.7 | 18.2 | 18.4 | 16.7 | 18.2 | 16.9 | 18.4 | 18.6 |
| | | | 3H | 17.8 | 19.1 | 18.0 | 19.4 | 19.6 | 18.0 | 19.4 | 18.3 | 19.6 | 19.9 |
| | | | 4H | 18.2 | 19.5 | 18.5 | 19.8 | 20.0 | 18.5 | 19.8 | 18.8 | 20.0 | 20.3 |
| | | | 6H | 18.5 | 19.7 | 18.8 | 20.0 | 20.2 | 18.8 | 20.0 | 19.1 | 20.3 | 20.5 |
| | | | 8H | 18.5 | 19.7 | 18.9 | 20.0 | 20.3 | 18.8 | 20.0 | 19.1 | 20.3 | 20.6 |
| | | | 12H | 18.5 | 19.6 | 18.9 | 19.9 | 20.2 | 18.8 | 19.9 | 19.1 | 20.2 | 20.5 |
| | 4H | | 2H | 17.0 | 18.4 | 17.4 | 18.6 | 18.9 | 17.2 | 18.5 | 17.5 | 18.8 | 19.0 |
| | | | 3H | 18.5 | 19.6 | 18.9 | 19.9 | 20.2 | 18.7 | 19.9 | 19.1 | 20.2 | 20.5 |
| | | | 4H | 19.1 | 20.1 | 19.4 | 20.4 | 20.8 | 19.3 | 20.4 | 19.7 | 20.7 | 21.0 |
| | | | 6H | 19.4 | 20.3 | 19.8 | 20.7 | 21.1 | 19.7 | 20.6 | 20.1 | 21.0 | 21.3 |
| | | | 8H | 19.5 | 20.4 | 19.9 | 20.7 | 21.1 | 19.8 | 20.6 | 20.2 | 21.0 | 21.4 |
| | | | 12H | 19.5 | 20.3 | 19.9 | 20.7 | 21.1 | 19.8 | 20.6 | 20.2 | 21.0 | 21.4 |
| | 8H | | 4H | 19.3 | 20.1 | 19.7 | 20.5 | 20.9 | 19.5 | 20.4 | 19.9 | 20.7 | 21.1 |
| | | | 6H | 19.7 | 20.4 | 20.2 | 20.8 | 21.3 | 20.0 | 20.7 | 20.4 | 21.1 | 21.5 |
| | | | 8H | 19.8 | 20.5 | 20.3 | 20.9 | 21.3 | 20.1 | 20.7 | 20.6 | 21.2 | 21.6 |
| | | | 12H | 19.9 | 20.4 | 20.4 | 20.9 | 21.3 | 20.1 | 20.7 | 20.6 | 21.1 | 21.6 |
| | 12H | | 4H | 19.3 | 20.0 | 19.7 | 20.4 | 20.8 | 19.5 | 20.3 | 19.9 | 20.7 | 21.1 |
| | | | 6H | 19.7 | 20.4 | 20.2 | 20.8 | 21.2 | 20.0 | 20.6 | 20.5 | 21.0 | 21.5 |
| | | | 8H | 19.9 | 20.4 | 20.3 | 20.9 | 21.3 | 20.1 | 20.7 | 20.6 | 21.1 | 21.6 |
| 不同间隔布灯时, 观察者位置引起的UGR变化 (CIE Pub.117): | | | | | | | | | | | | | |
| S = 1.0H | | + 0.2 / - 0.3 | | | | | + 0.2 / - 0.3 | | | | | | |
| 1.5H | | + 0.2 / - 0.4 | | | | | + 0.2 / - 0.4 | | | | | | |
| 2.0H | | + 0.3 / - 0.3 | | | | | + 0.2 / - 0.4 | | | | | | |

依据CIE Pub.117计算, 633.5lm光源光通表格中的数据需要进行修正 ($81\log(F/F_0) = -1.6$).
 出光口面积: 0.111111 m²

C角度范围: 0度 - 360度
 C角度间隔: 22.5度
 测试速度: 快速
 环境温度: 25.3°C
 测试人员:
 测试日期: 2023-02-02

γ角度范围: 0度 - 90度
 γ角度间隔: 1.0度
 测试系统: 远方 (EVERFINE) GO-SPEX500_V1 系统 V2.00.460
 环境湿度: 65.0%
 测试距离: 3.090米 [K=1.0000]
 备注:

UF利用系数表

| | | |
|--|-------|-------|
| 实测参数: U:119.75V I:0.1033A P:9.2100W PF:0.7442 Freq:59.98Hz UTHDi:0.00% ITHDi:0.00% KDisp:0 实检光通: 633.468x1 lm | | |
| 灯具名称: LED-S9W-5CCT-WH-SQ-BF | 灯具类型: | 灯具重量: |
| 灯具规格: 2700K | 外型尺寸: | 测试编号: |
| 制造厂商: | 发光口面: | 遮光角: |


| 反 射 比 / REFLECTANCE | | | | | | | | | | |
|----------------------------|---|-----|-----|-----|-----|----------------------|-----|-----|-----|---------|
| 天花板 | 0.8 | 0.8 | 0.8 | 0.7 | 0.7 | 0.7 | 0.5 | 0.5 | 0.5 | 0 |
| 墙壁 | 0.7 | 0.5 | 0.3 | 0.7 | 0.5 | 0.3 | 0.7 | 0.5 | 0.3 | 0 |
| 工作面 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0 |
| 室形指数 | 利用系数 UTILIZATION FACTORS (%) $k(RI) \times RCR = 5$ | | | | | | | | | |
| k = 0.60 | 59 | 47 | 40 | 58 | 47 | 40 | 57 | 46 | 40 | 34 |
| 0.80 | 69 | 57 | 50 | 68 | 57 | 50 | 66 | 56 | 50 | 43 |
| 1.00 | 77 | 66 | 59 | 76 | 66 | 59 | 74 | 67 | 58 | 51 |
| 1.25 | 84 | 74 | 67 | 83 | 73 | 67 | 80 | 72 | 66 | 59 |
| 1.50 | 89 | 80 | 73 | 88 | 79 | 72 | 85 | 77 | 71 | 64 |
| 2.00 | 96 | 88 | 82 | 94 | 87 | 81 | 91 | 84 | 79 | 72 |
| 2.50 | 100 | 92 | 87 | 98 | 91 | 86 | 94 | 88 | 84 | 76 |
| 3.00 | 103 | 97 | 91 | 101 | 95 | 90 | 97 | 92 | 88 | 80 |
| 4.00 | 107 | 102 | 97 | 105 | 100 | 96 | 100 | 96 | 93 | 84 |
| 5.00 | 109 | 105 | 101 | 107 | 103 | 99 | 102 | 99 | 96 | 87 |
| ROOM INDEX | UF (总) | | | | | | | | | UF (直接) |
| 依据标准文件 DIN EN 13032-2 2004 | | | 悬挂灯 | | | 安装距高比 SHR NOM = 1.25 | | | | |

C角度范围: 0度 - 360度
C角度间隔: 22.5度
测试速度: 快速
环境温度: 25.3°C
测试人员:
测试日期: 2023-02-02

γ角度范围: 0度 - 90度
γ角度间隔: 1.0度
测试系统: 远方 (EVERFINE) GO-SPEX500_V1 系统 V2.00.460
环境湿度: 65.0%
测试距离: 3.090米 [K=1.0000]
备注:

灯具等光强曲线

| | | |
|--|-------|-------|
| 实测参数: U:119.75V I:0.1033A P:9.2100W PF:0.7442 Freq:59.98Hz UTHDi:0.00% ITHDi:0.00% KDisp:0 实检光通: 633.468x1 lm | | |
| 灯具名称: LED-S9W-5CCT-WH-SQ-BF | 灯具类型: | 灯具重量: |
| 灯具规格: 2700K | 外型尺寸: | 测试编号: |
| 制造厂商: | 发光口面: | 遮光角: |

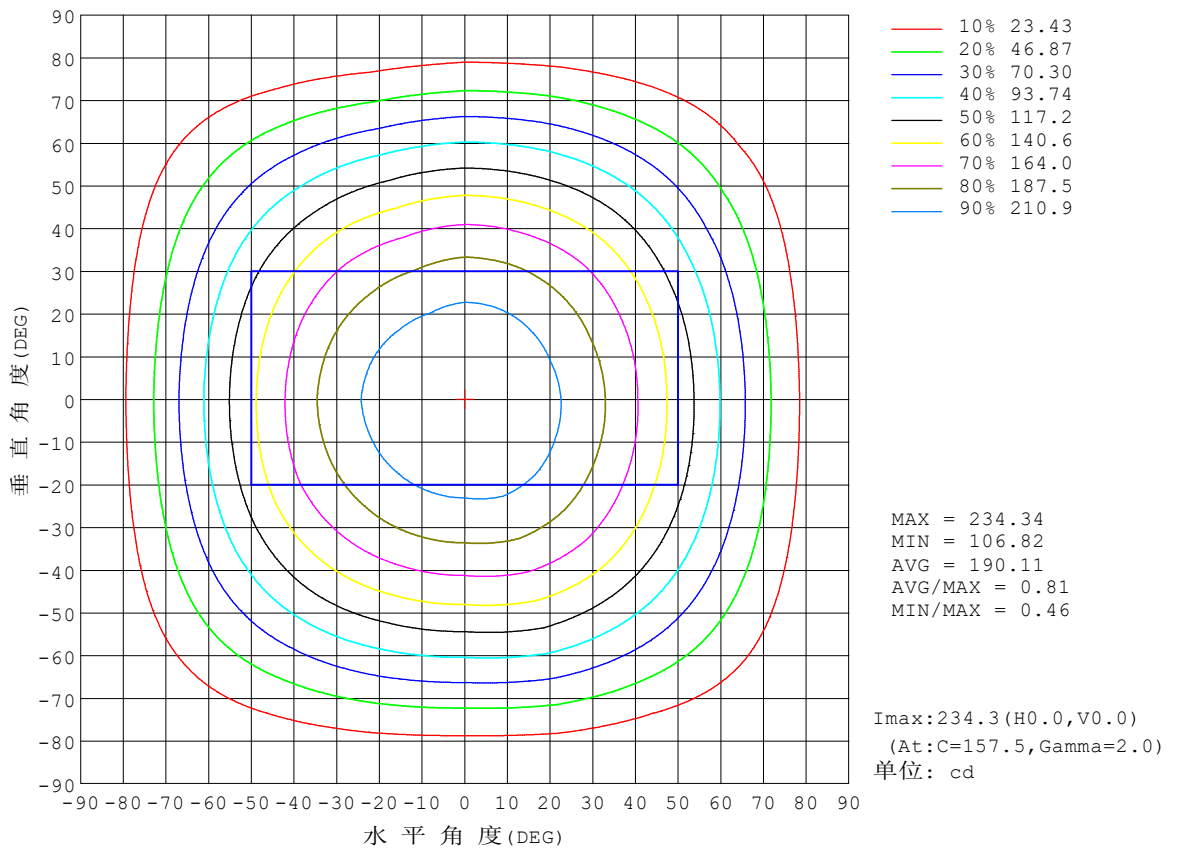


C角度范围: 0度 - 360度
C角度间隔: 22.5度
测试速度: 快速
环境温度: 25.3℃
测试人员:
测试日期: 2023-02-02

γ角度范围: 0度 - 90度
γ角度间隔: 1.0度
测试系统: 远方 (EVERFINE) GO-SPEX500_V1 系统 V2.00.460
环境湿度: 65.0%
测试距离: 3.090米 [K=1.0000]
备注:

灯具有效平均照度图

| | | |
|--|-------|-------|
| 实测参数: U:119.75V I:0.1033A P:9.2100W PF:0.7442 Freq:59.98Hz UTHDi:0.00% ITHDi:0.00% KDisp:0 实检光通: 633.468x1 lm | | |
| 灯具名称: LED-S9W-5CCT-WH-SQ-BF | 灯具类型: | 灯具重量: |
| 灯具规格: 2700K | 外型尺寸: | 测试编号: |
| 制造厂商: | 发光口面: | 遮光角: |

光通输出:466.4 lm

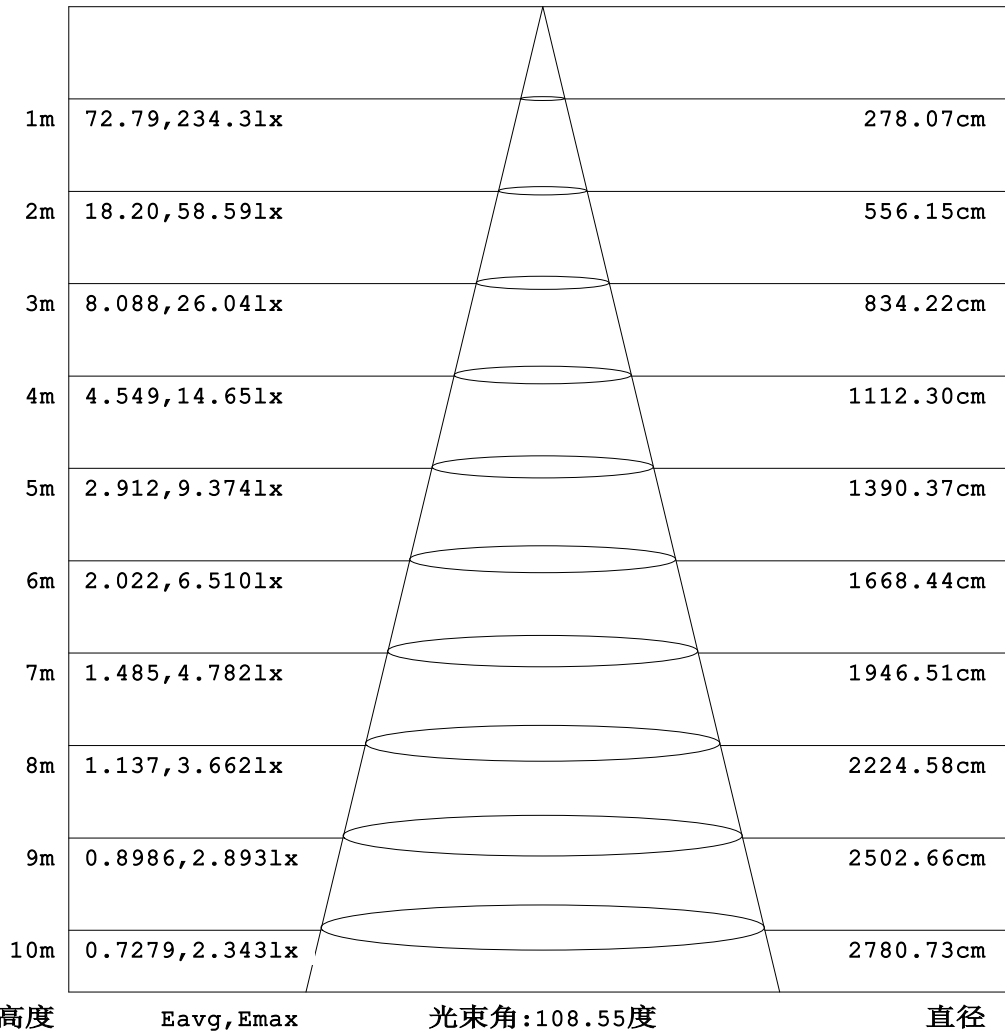


注:曲线为灯具在不同投射距离下的照射区域及区域内平均照度.

C角度范围: 0度 - 360度
 C角度间隔: 22.5度
 测试速度: 快速
 环境温度: 25.3℃
 测试人员:
 测试日期: 2023-02-02

γ角度范围: 0度 - 90度
 γ角度间隔: 1.0度
 测试系统: 远方(EVERFINE)GO-SPEX500_V1系统 V2.00.460
 环境湿度: 65.0%
 测试距离: 3.090米 [K=1.0000]
 备注:

平面等照度曲线

| | | |
|--|-------|-------|
| 实测参数: U:119.75V I:0.1033A P:9.2100W PF:0.7442 Freq:59.98Hz UTHDi:0.00% ITHDi:0.00% KDisp:0 实检光通: 633.468x1 lm | | |
| 灯具名称: LED-S9W-5CCT-WH-SQ-BF | 灯具类型: | 灯具重量: |
| 灯具规格: 2700K | 外型尺寸: | 测试编号: |
| 制造厂商: | 发光口面: | 遮光角: |

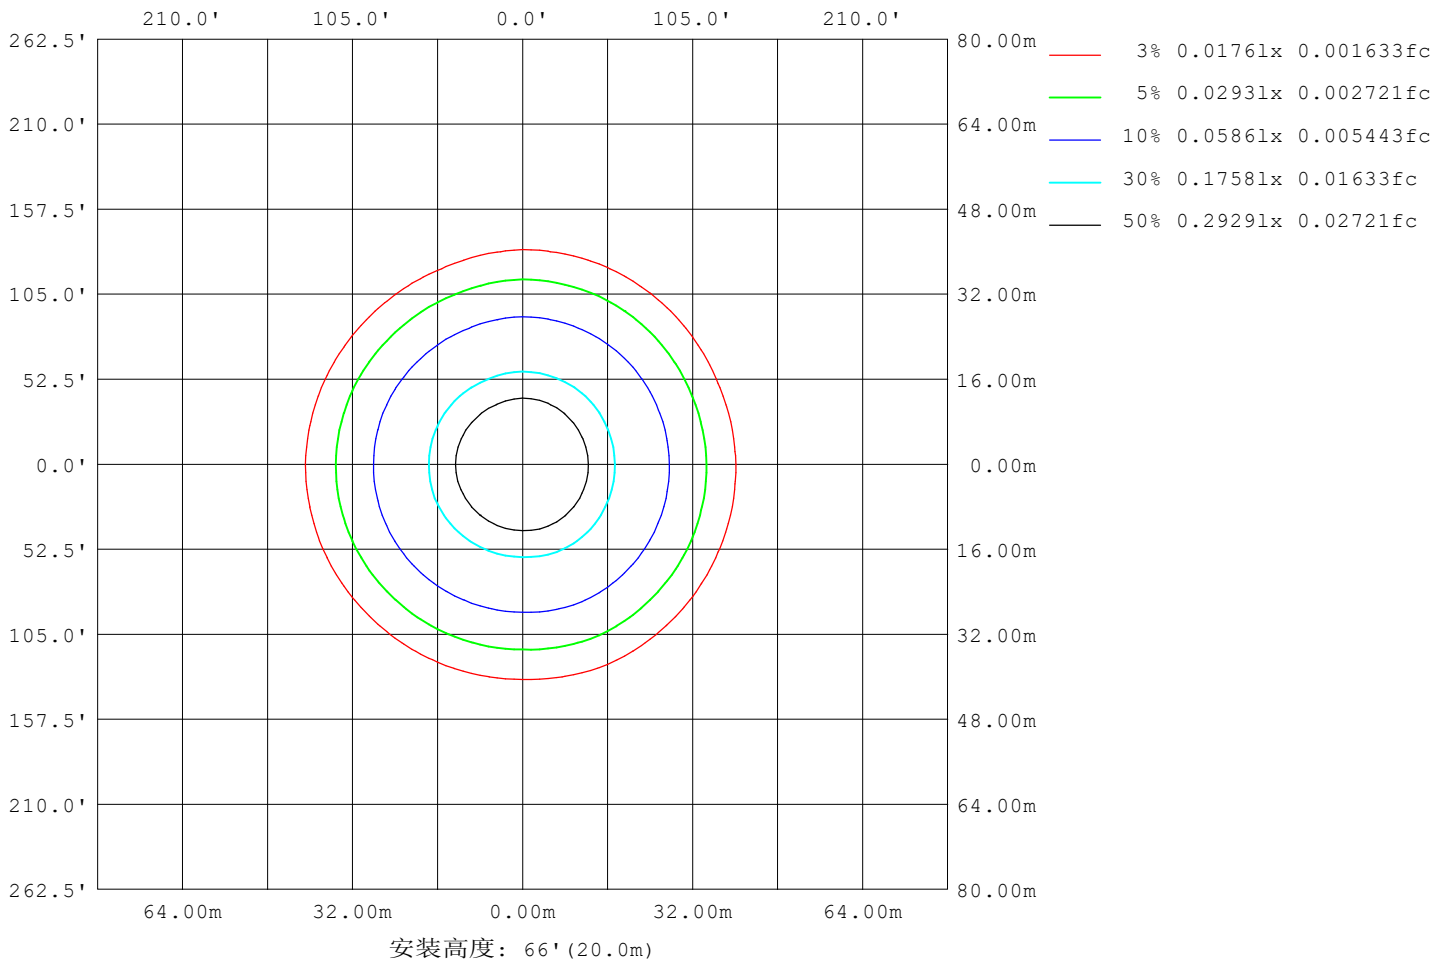

C角度范围: 0度 - 360度
 C角度间隔: 22.5度
 测试速度: 快速
 环境温度: 25.3°C
 测试人员:
 测试日期: 2023-02-02

γ角度范围: 0度 - 90度
 γ角度间隔: 1.0度
 测试系统: 远方 (EVERFINE) GO-SPEX500_V1 系统 V2.00.460
 环境湿度: 65.0%
 测试距离: 3.090米 [K=1.0000]
 备注:

LED筒灯平均亮度报告

| | | |
|--|-------|-------|
| 实测参数: U:119.75V I:0.1033A P:9.2100W PF:0.7442 Freq:59.98Hz UTHDi:0.00% ITHDi:0.00% KDisp:0 实检光通: 633.468x1 lm | | |
| 灯具名称: LED-S9W-5CCT-WH-SQ-BF | 灯具类型: | 灯具重量: |
| 灯具规格: 2700K | 外型尺寸: | 测试编号: |
| 制造厂商: | 发光口面: | 遮光角: |


| 平均亮度 | 数值 (cd/m ²) |
|-------------|-------------------------|
| L横 (65) av | 1606 |
| L横 (75) av | 1281 |
| L横 (85) av | 489 |
| L纵 (65) av | 1605 |
| L纵 (75) av | 1282 |
| L纵 (85) av | 439 |
| L45 (65) av | 1582 |
| L45 (75) av | 1209 |
| L45 (85) av | 311 |

注:依据标准 GB/T 29293-2012 计算

C角度范围: 0度 - 360度
C角度间隔: 22.5度
测试速度: 快速
环境温度: 25.3℃
测试人员:
测试日期: 2023-02-02

γ角度范围: 0度 - 90度
γ角度间隔: 1.0度
测试系统: 远方 (EVERFINE) GO-SPEX500_V1 系统 V2.00.460
环境湿度: 65.0%
测试距离: 3.090米 [K=1.0000]
备注:

平面照度曲线

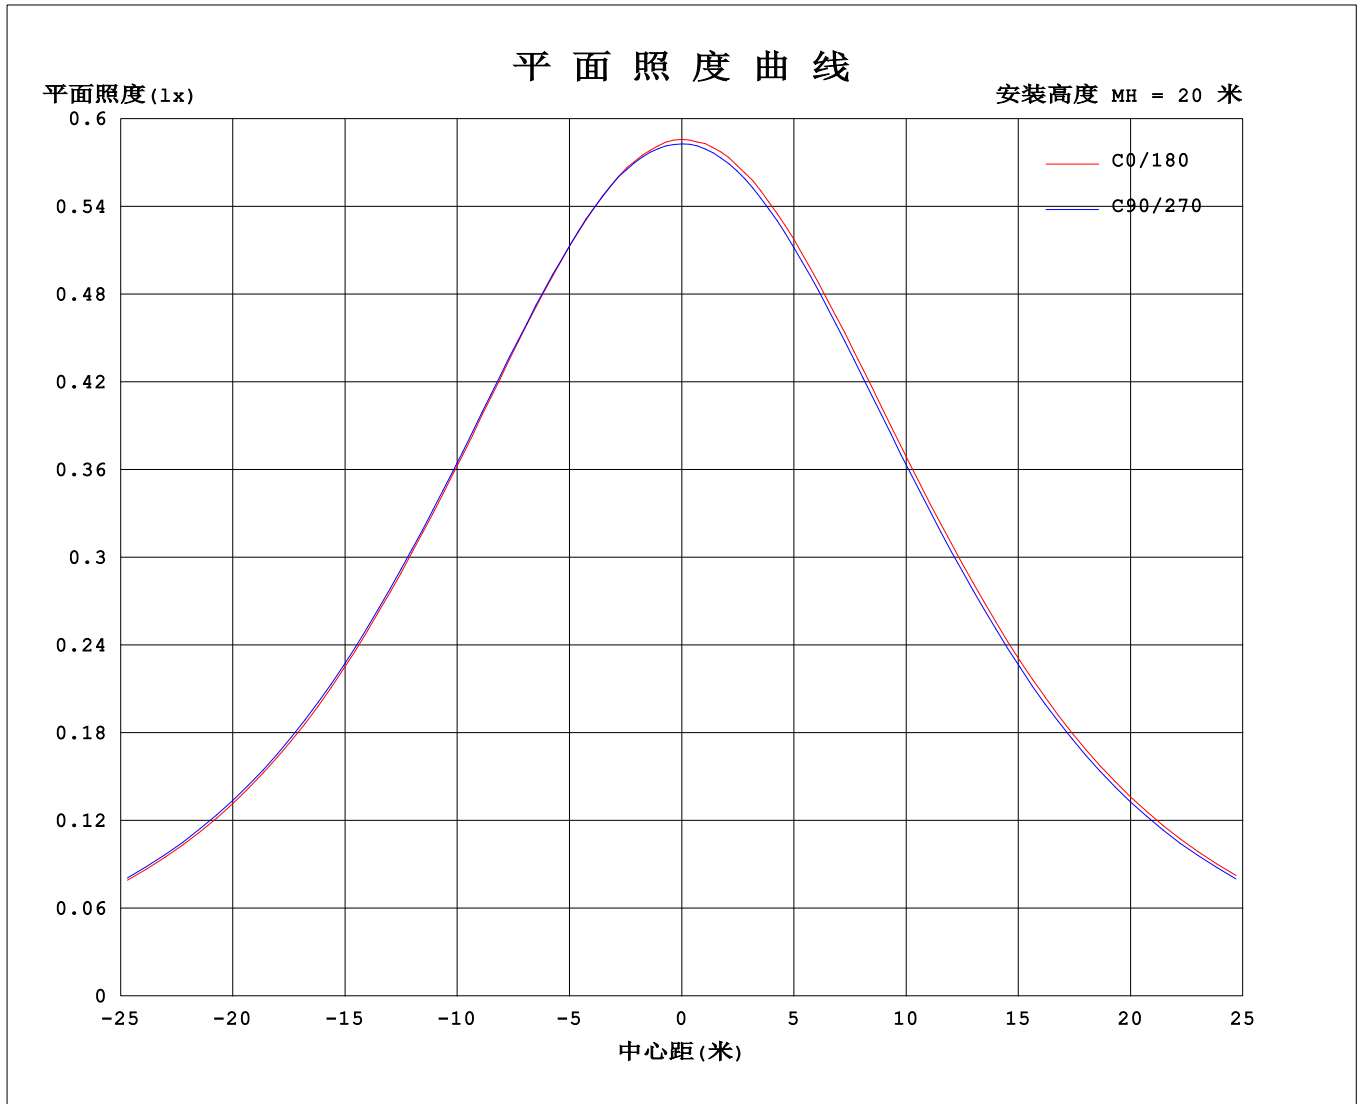

C角度范围: 0度 - 360度
C角度间隔: 22.5度
测试速度: 快速
环境温度: 25.3℃
测试人员:
测试日期: 2023-02-02

γ角度范围: 0度 - 90度
γ角度间隔: 1.0度
测试系统: 远方 (EVERFINE) GO-SPEX500_V1 系统 V2.00.460
环境湿度: 65.0%
测试距离: 3.090米 [K=1.0000]
备注:

